
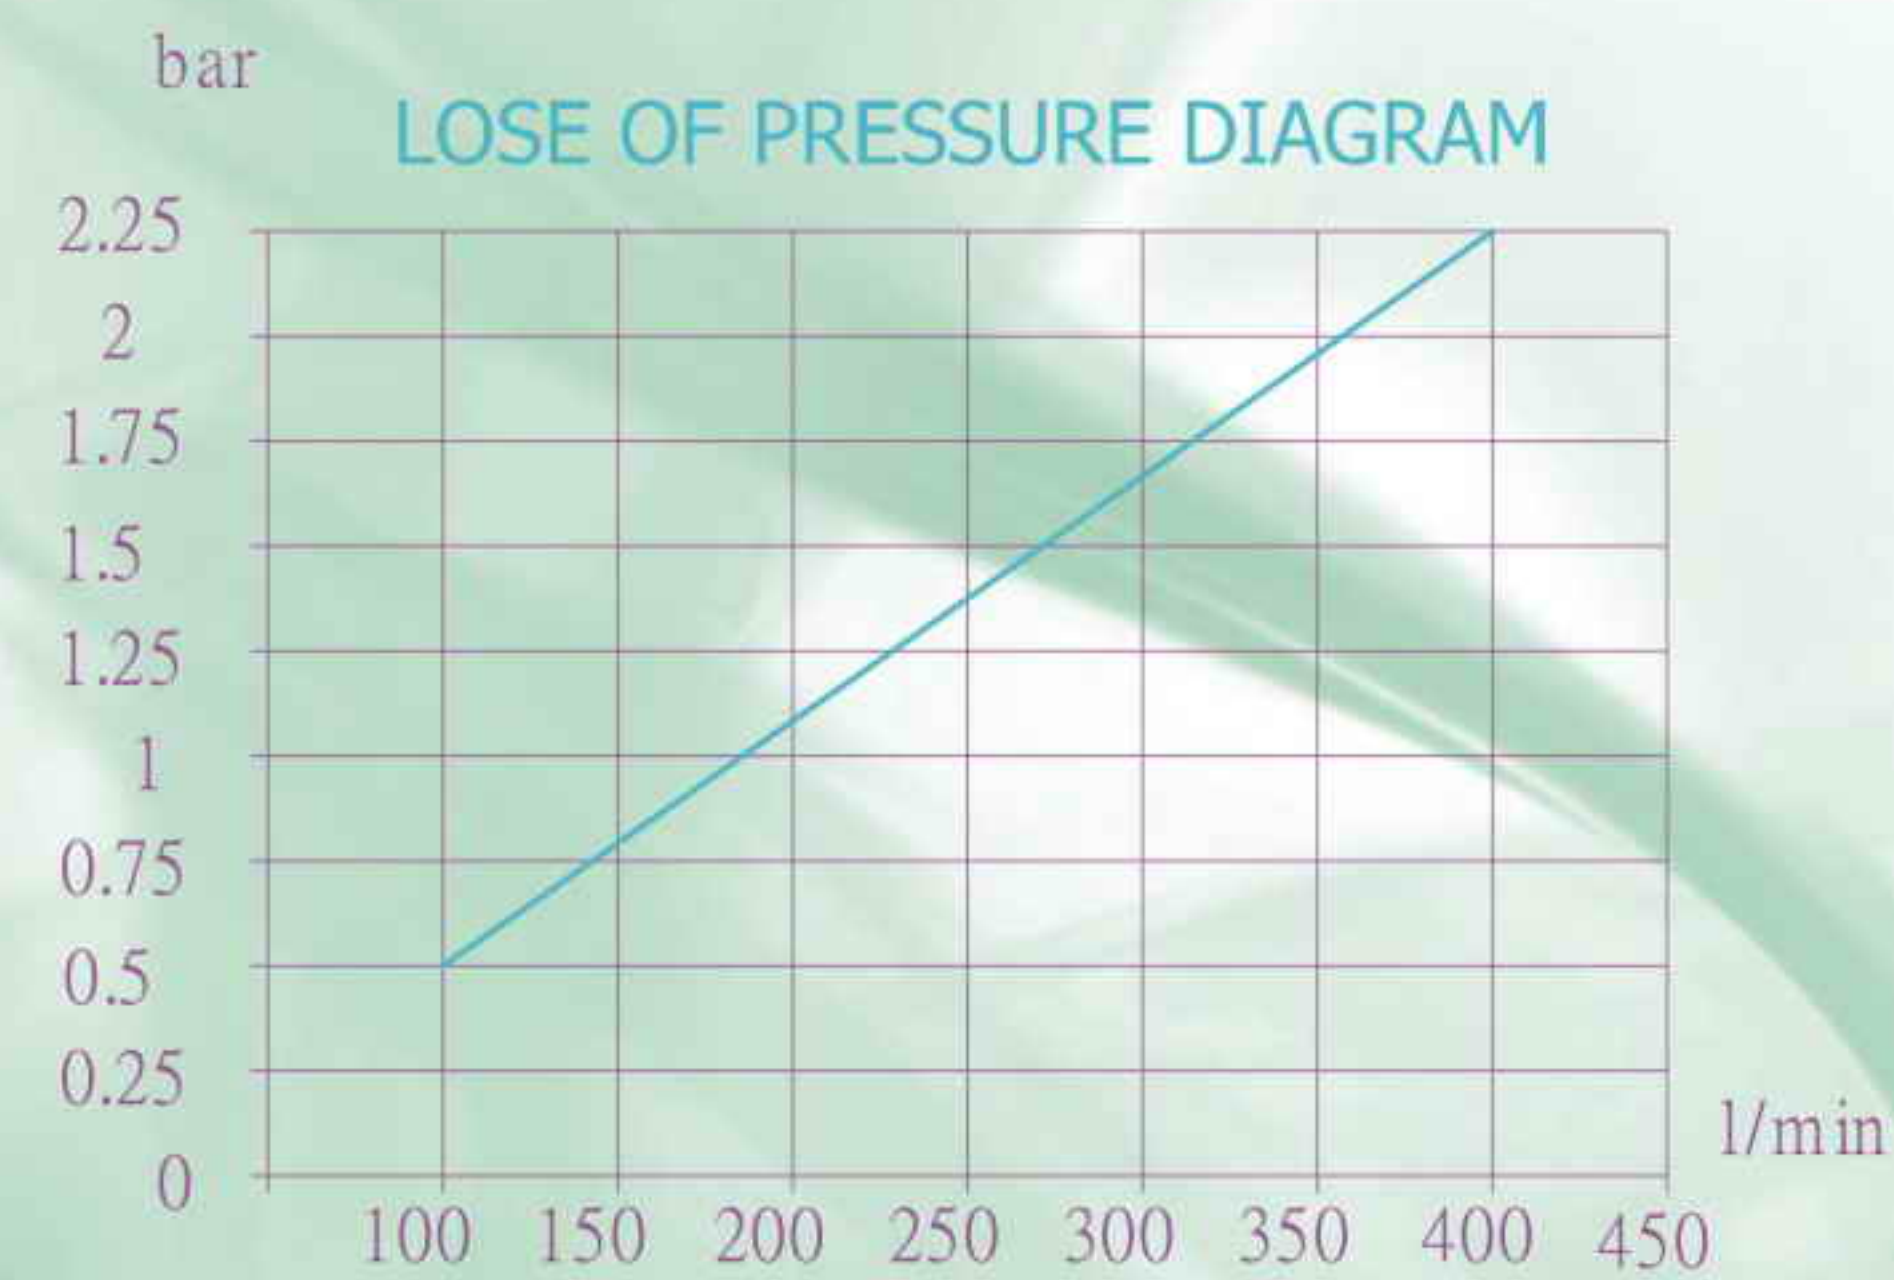


AH2342A-CA*

To preserve the heat exchanger, when installed on the return line of the system, a by-pass valve should always be mounted. An alternate piping method used a separate circuit from the reservoir with a small pump to drive the oil through the heat exchanger.

Oil-flow L/min	Voltage V	Hz	W	A	R.P.M.	Air flow m ³ /h	IP	Noise dB(A)	Safety Reg.
50 - 250	210-230/360-400	50	1.5Kw	6.15-6.25 / 2.56-3.78	1400	7,600	55		CE
	240-270/420-460	60	1.72Kw	6.15-6.25 / 2.56-3.78	1680	9,120	55		CE

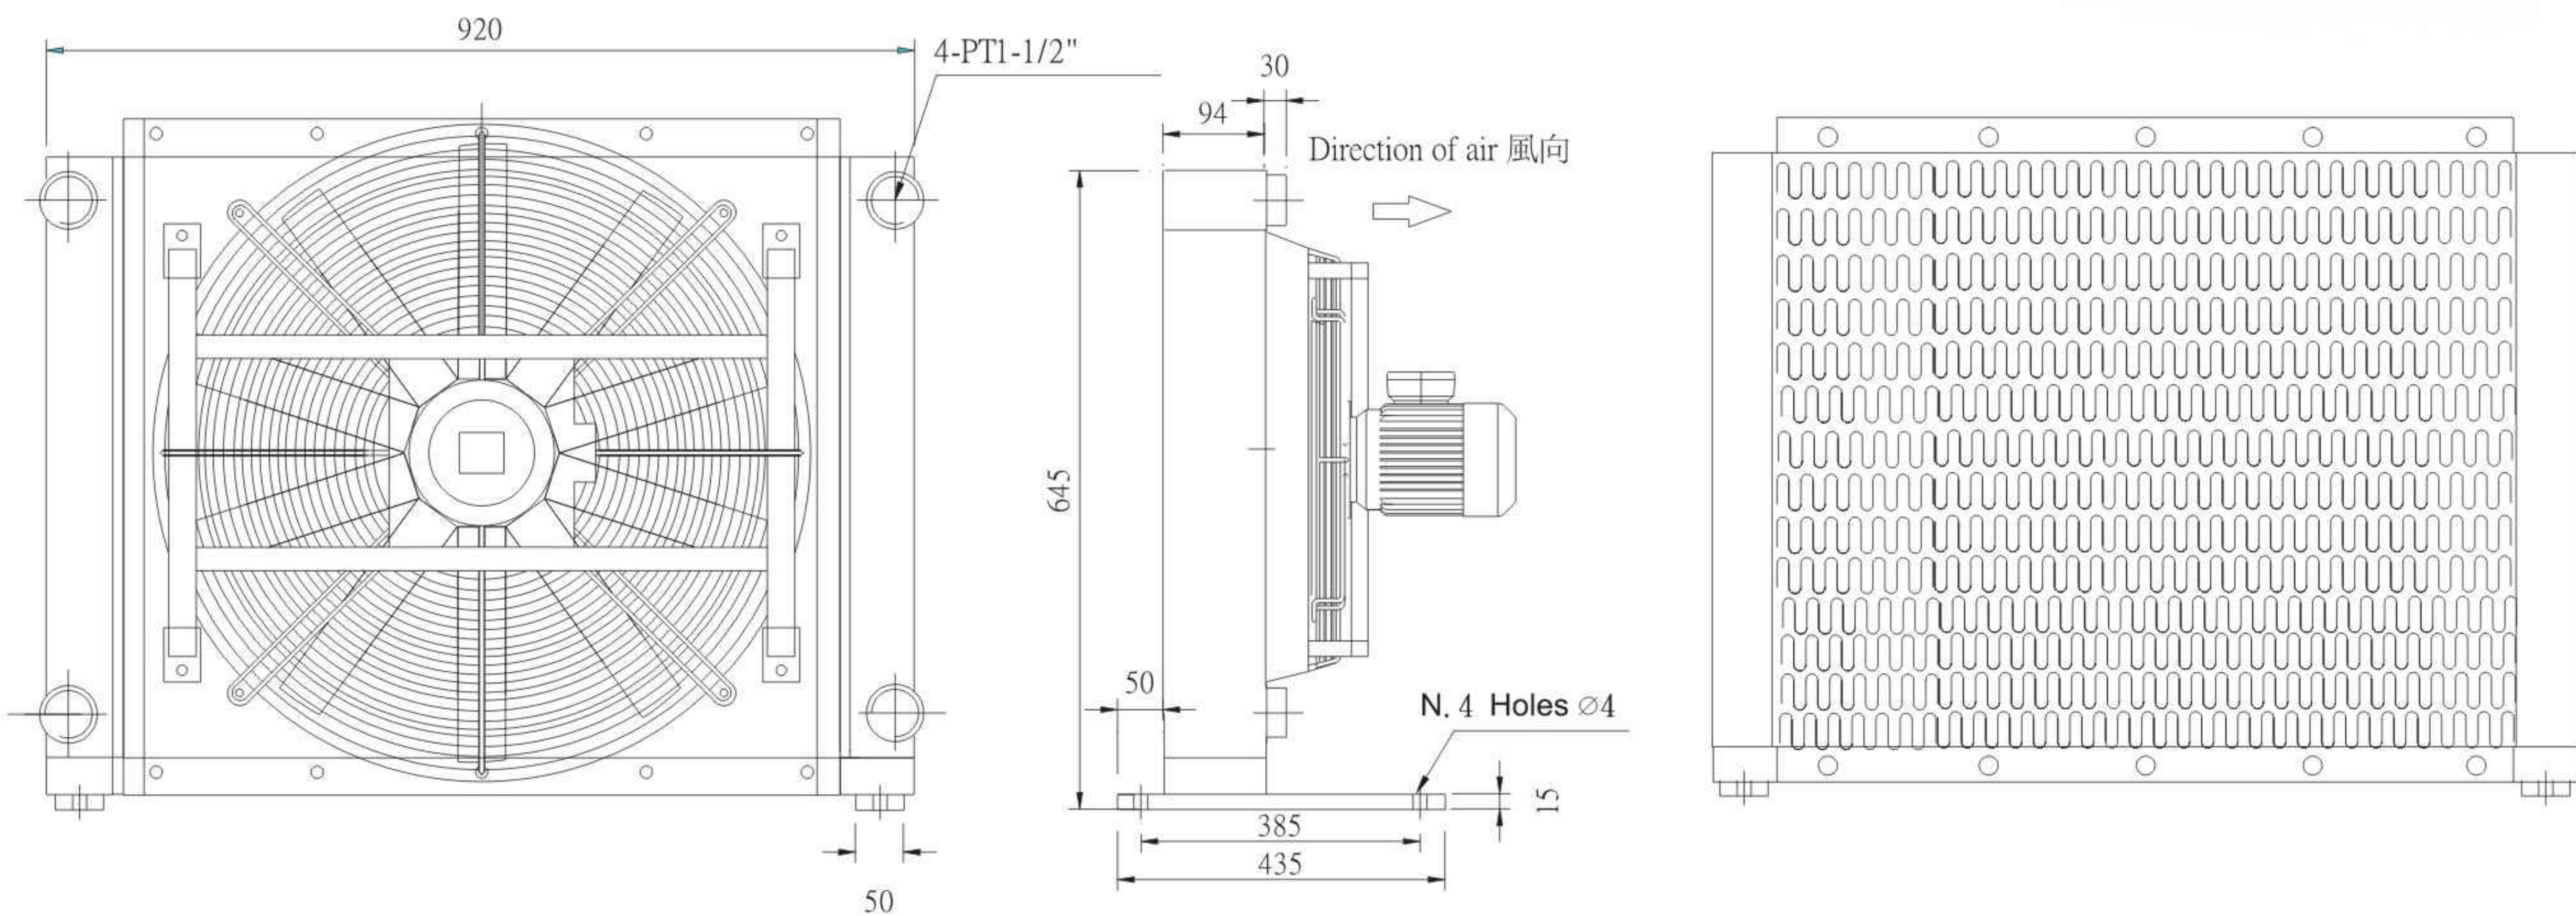

- AH
- 23
- 42
- C
- A*
- AC230/380/400/415/440
2HP , 3Phase
 - Fan case
 - Heat-exchanger model
 - ϕ Fan in inch : 23" , ϕ 560m/m
 - Heat-exchanger type