
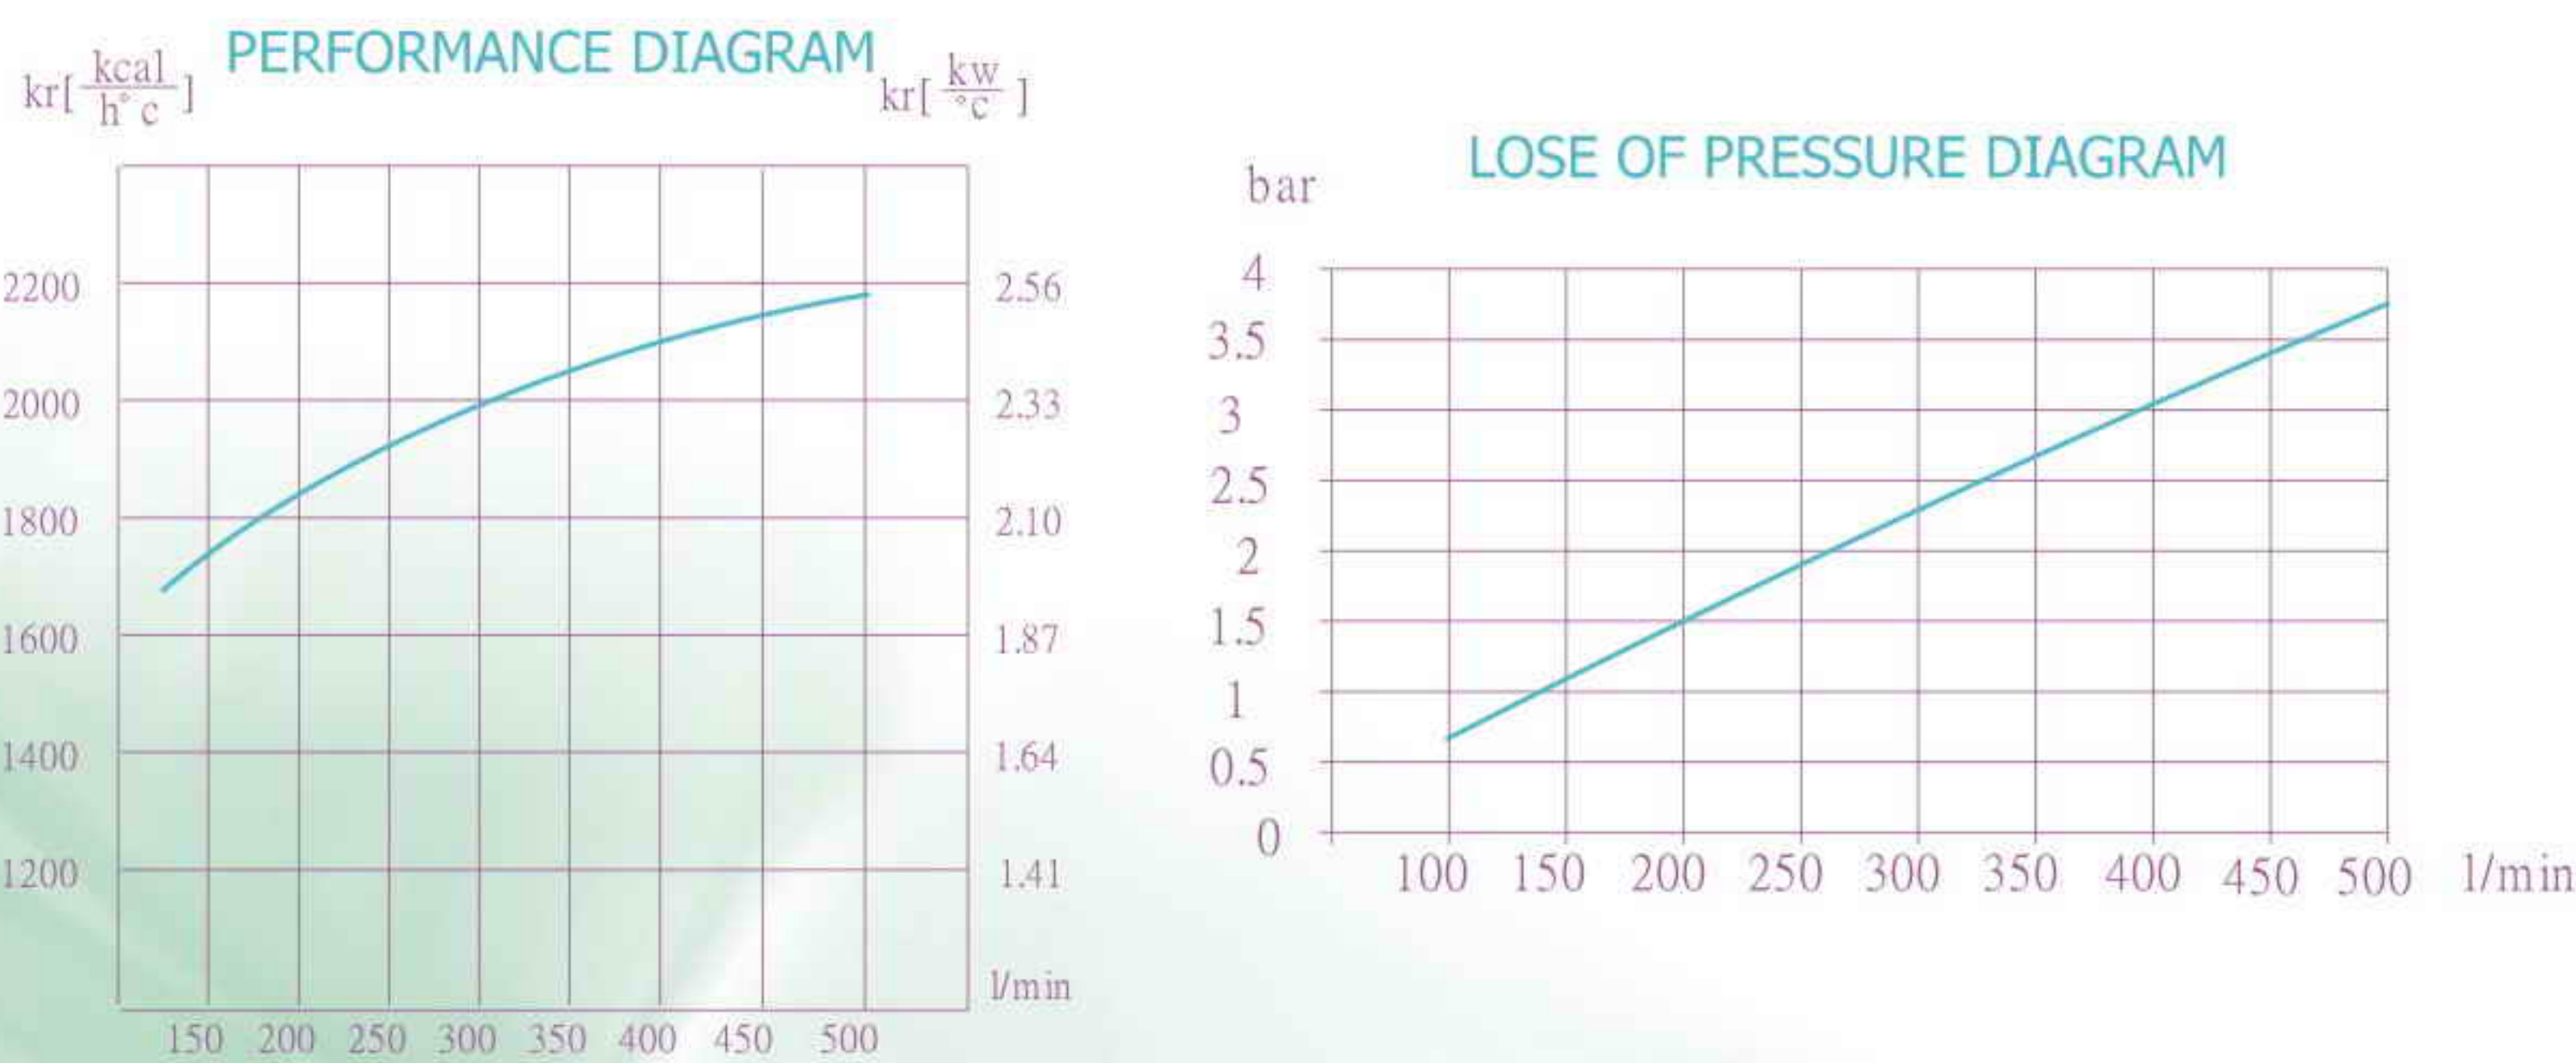


AH2890-CA*

To preserve the heat exchanger, when installed on the return line of the system, a by-pass valve should always be mounted. An alternate piping method used a separate circuit from the reservoir with a small pump to drive the oil through the heat exchanger.

Oil-flow L/min	Voltage V	Hz	W	A 6 POLES	R.P.M.	Air flow m ³ /h	IP	Noise dB(A)	Safety Reg.
100 - 350	210-230/360-400	50	2.2Kw	9.89-9.51/ 5.71-5.49	955	16,500	55		CE
	240-270/420-460	60	2.6Kw	9.89-9.51/ 5.71-5.49	1150	19,800	55		CE

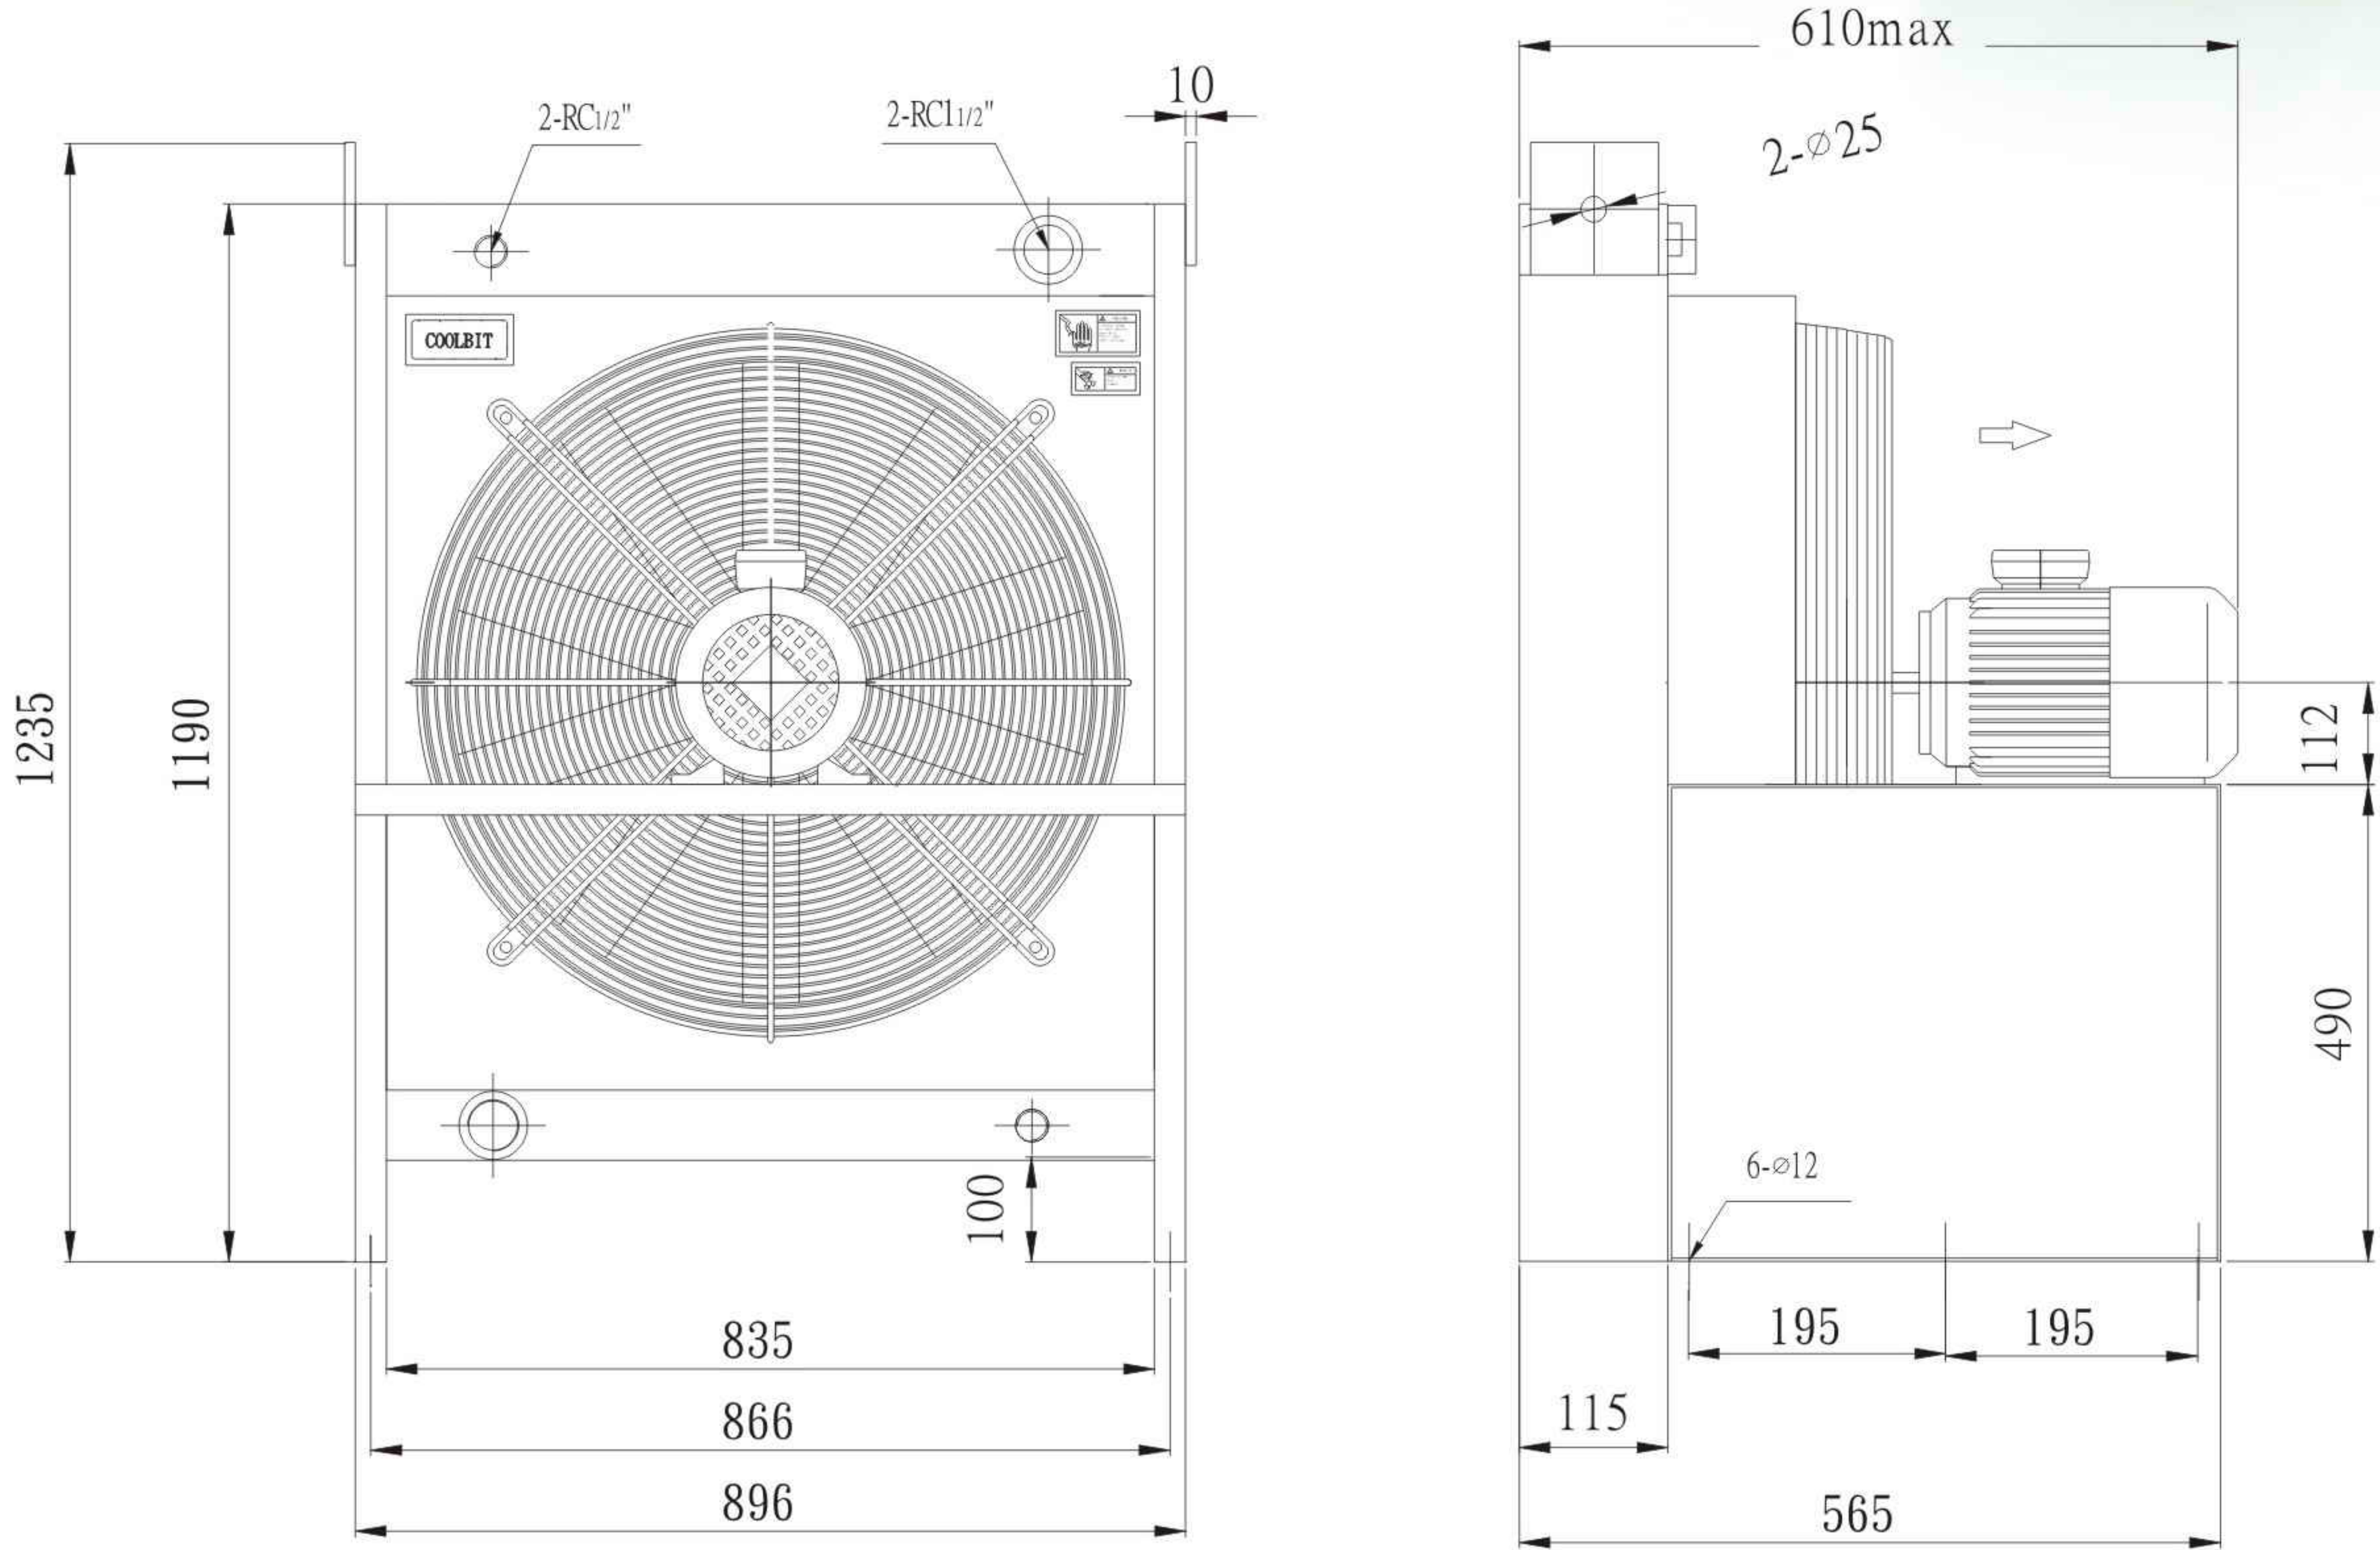

- AH 28 90 C A*

AC230/580/400/415/440

3HP , 3Phase , 6Poles

Fan case

Heat-exchanger model

ø Fan in inch : 23" , ø 560m/m

Heat-exchanger type

